


# Haiku et i6 – éloignement des obstructions

Mesurer la distance à partir du haut de la pale jusqu'au plafond ou la première obstruction au-dessus du ventilateur

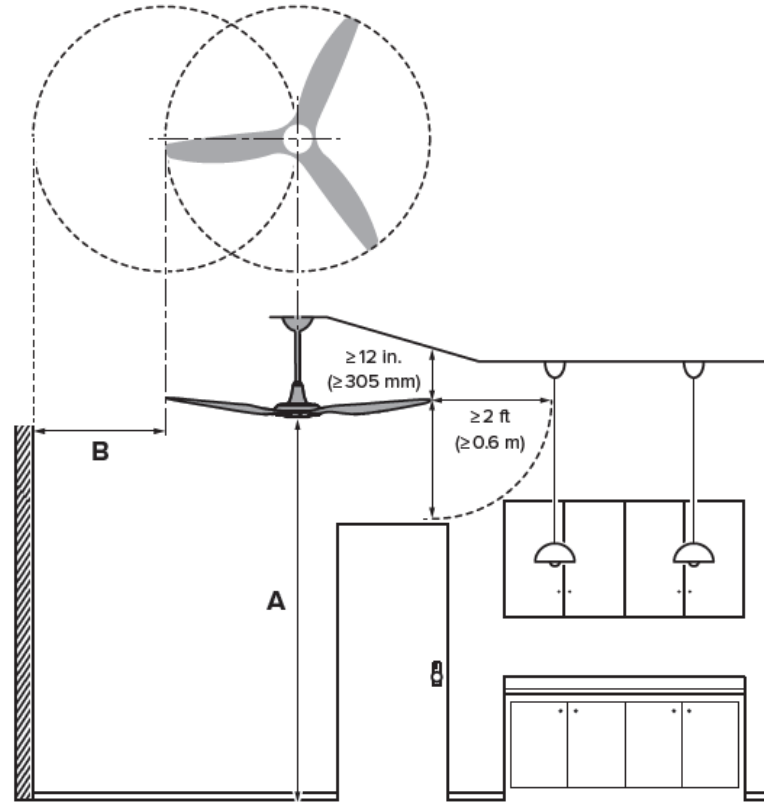

	Distance du plafond	Distance d'une obstruction	Distance du sol	Distance du mur
<b>84 in. (2134 mm)</b>	≥ 12 in. (≥ 305 mm)	≥ 2 ft (≥ 0.6 m)	≥ 8 ft (≥ 2.4 m)	≥ 42 in. (≥ 1067 mm)
<b>72 in. (1829 mm)</b>	≥ 12 in. (≥ 305 mm)	≥ 2 ft (≥ 0.6 m)	≥ 8 ft (≥ 2.4 m)	≥ 36 in. (≥ 914 mm)
<b>60 in. (1524 mm)</b>	≥ 12 in. (≥ 305 mm)	≥ 2 ft (≥ 0.6 m)	≥ 7 ft (≥ 2.1 m)	≥ 30 in. (≥ 762 mm)
<b>52 in. (1321 mm)</b>	≥ 12 in. (≥ 305 mm)	≥ 2 ft (≥ 0.6 m)	≥ 7 ft (≥ 2.1 m)	≥ 26 in. (≥ 660 mm)

Diamètre